
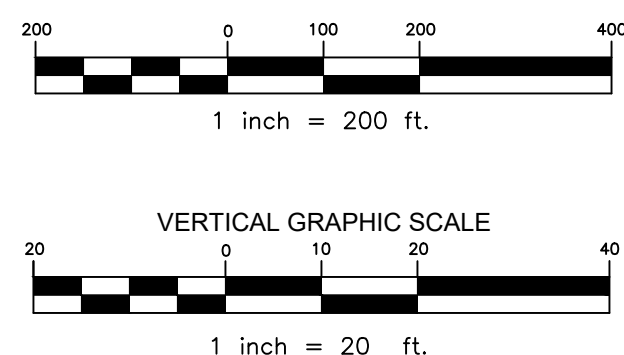
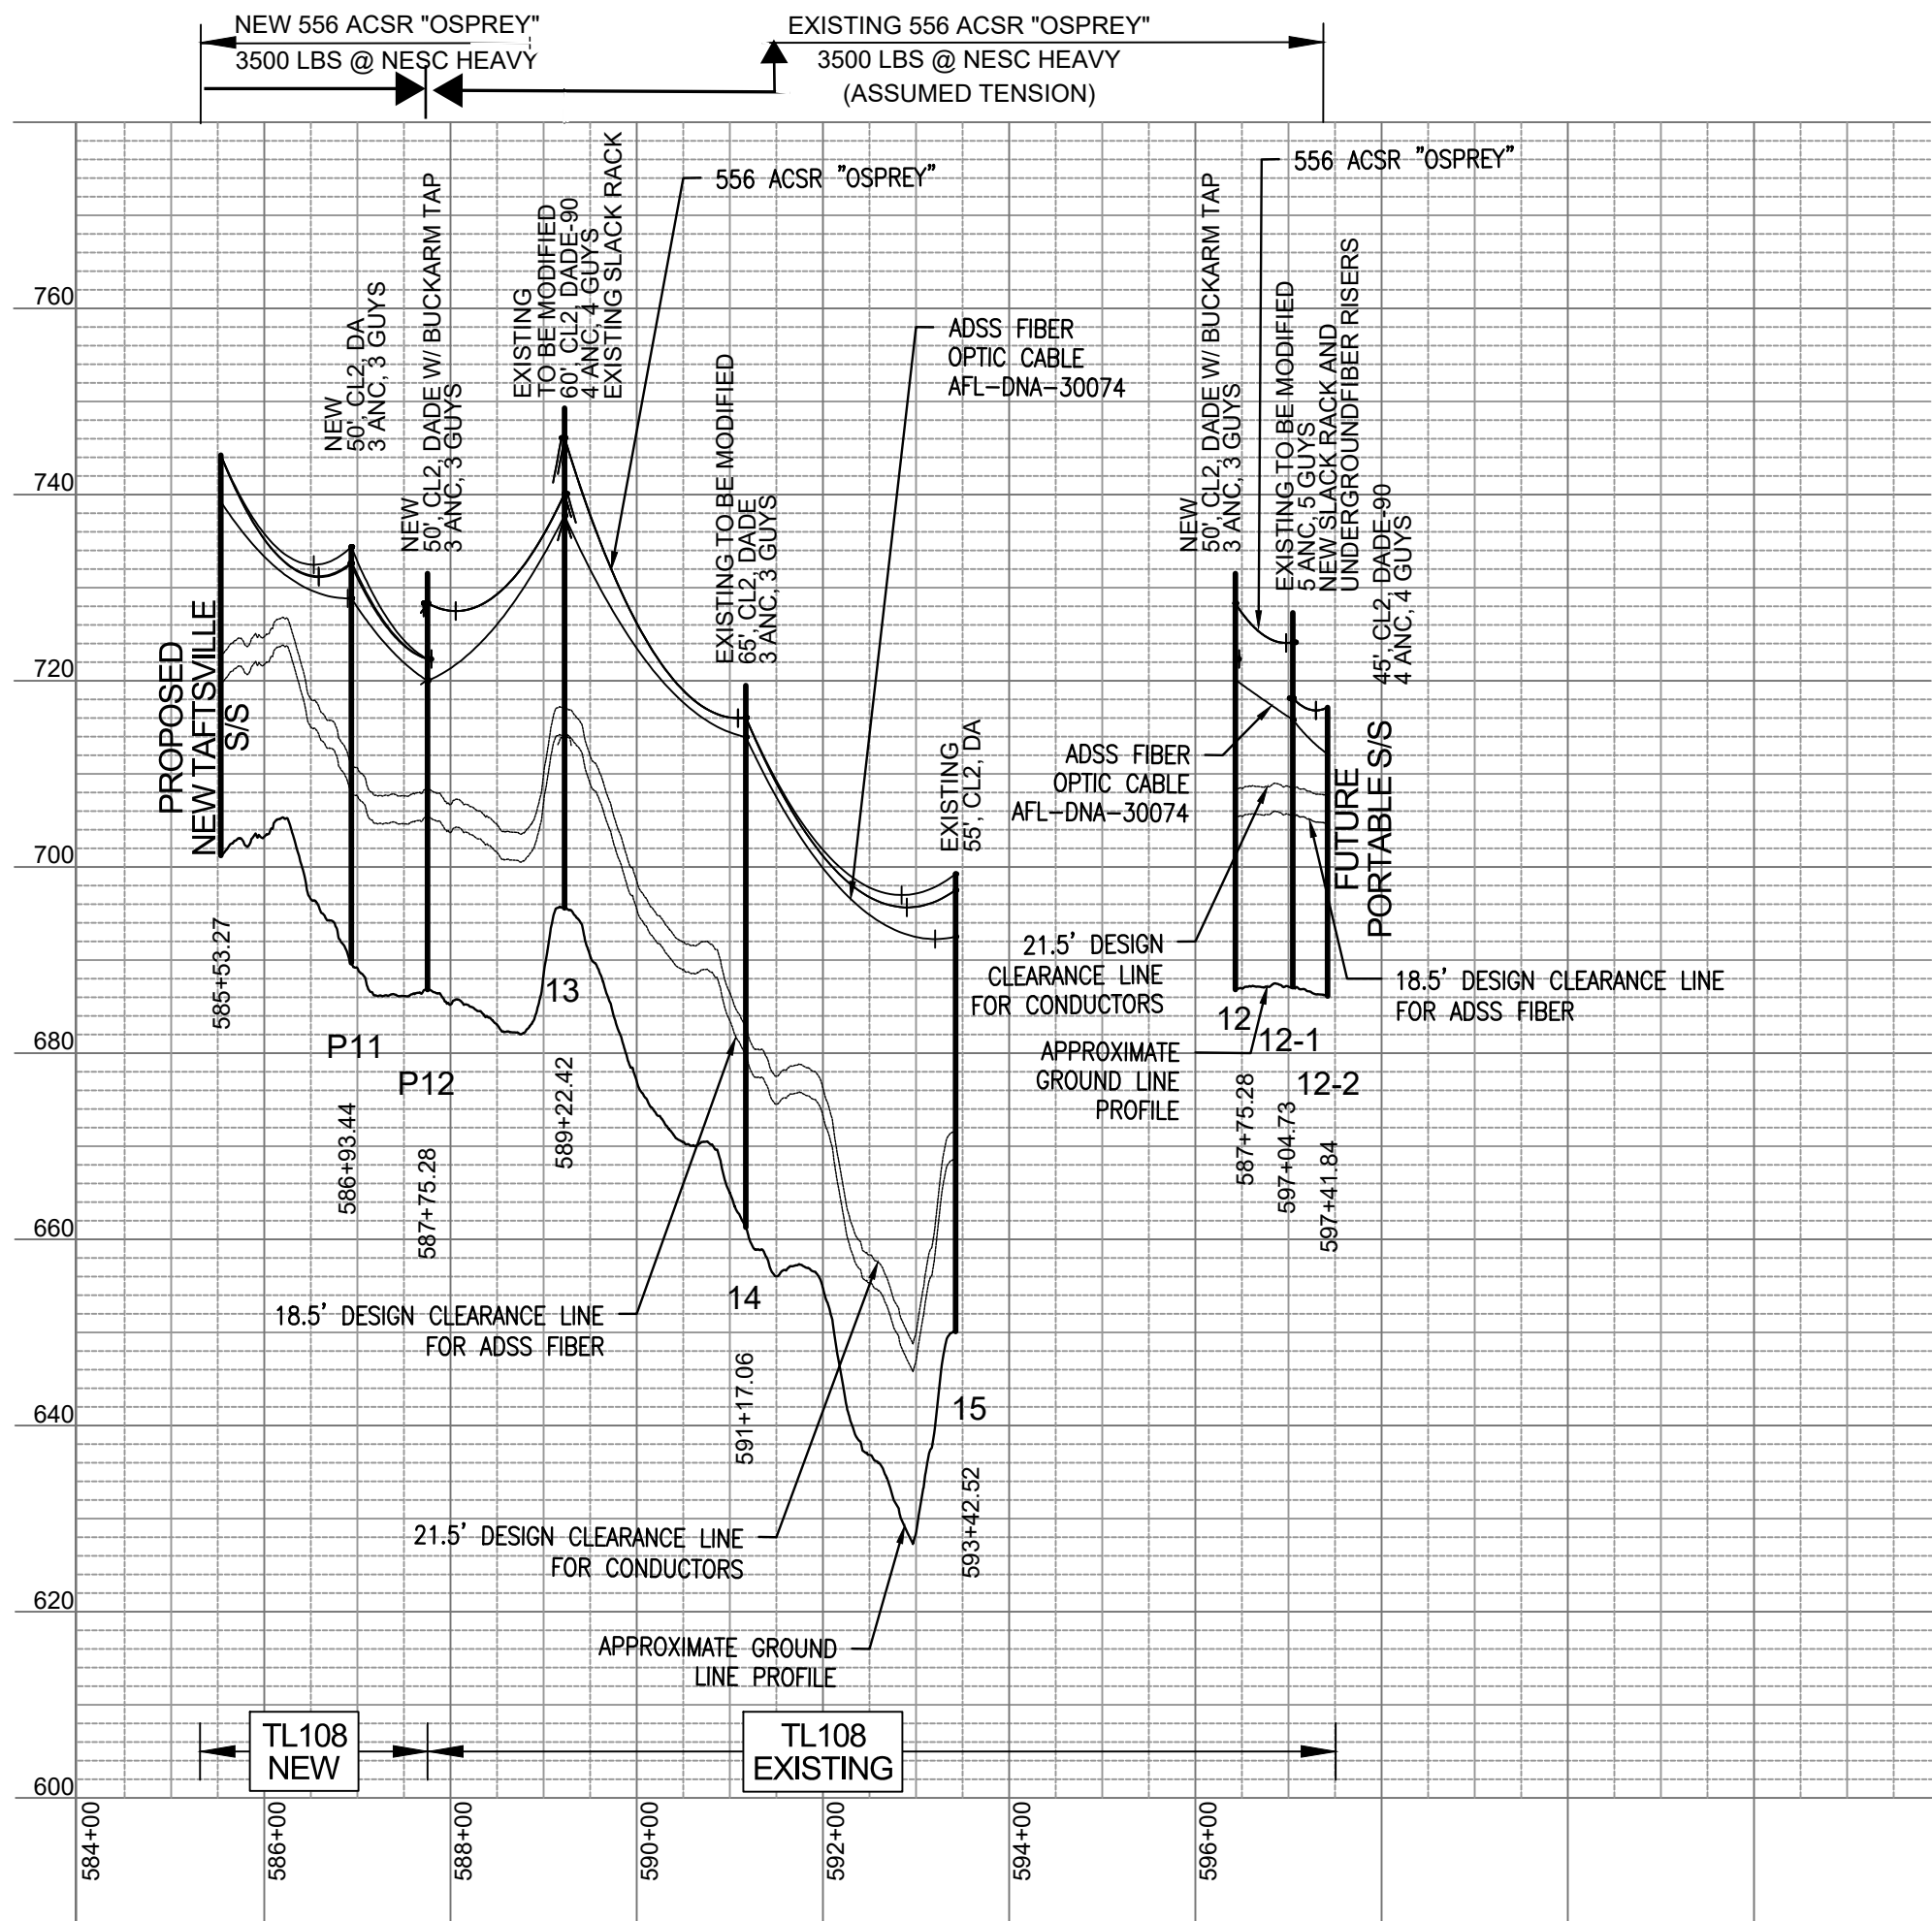
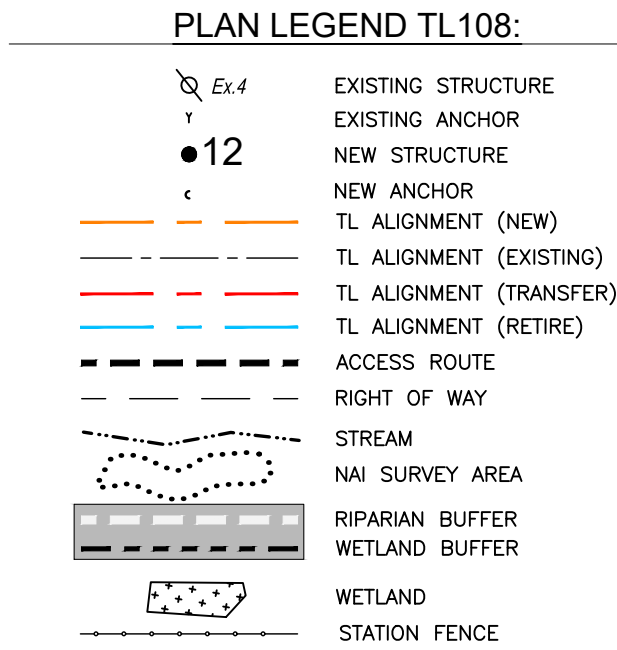


NOTES:
1. TL108 556 ACSR 18/1 "OSPREY" DISPLAYED @ 170°F.
2. TL105 795 ACSR 26/7 "DRAKE" DISPLAYED @ 170°F.
3. ADSS FIBER OPTIC CABLE, 72 COUNT AFL, DNA-30074 DISPLAYED @ 90°F
AND DESIGN TENSION OF 200 LBS @ 60°F (INITIAL).
4. EXISTING FIBER RUN FROM TL108 P10 TO P13 TO BE ROLLED BACK TO
EXISTING P13 SLACK RACK.
5. AERIAL IMAGERY FROM PUBLIC SOURCES.
6. SEE STRUCTURE LIST FOR ADDITIONAL INFORMATION.
7. WETLANDS PROVIDED BY GMP.

EXHIBIT GMP JRF-12B

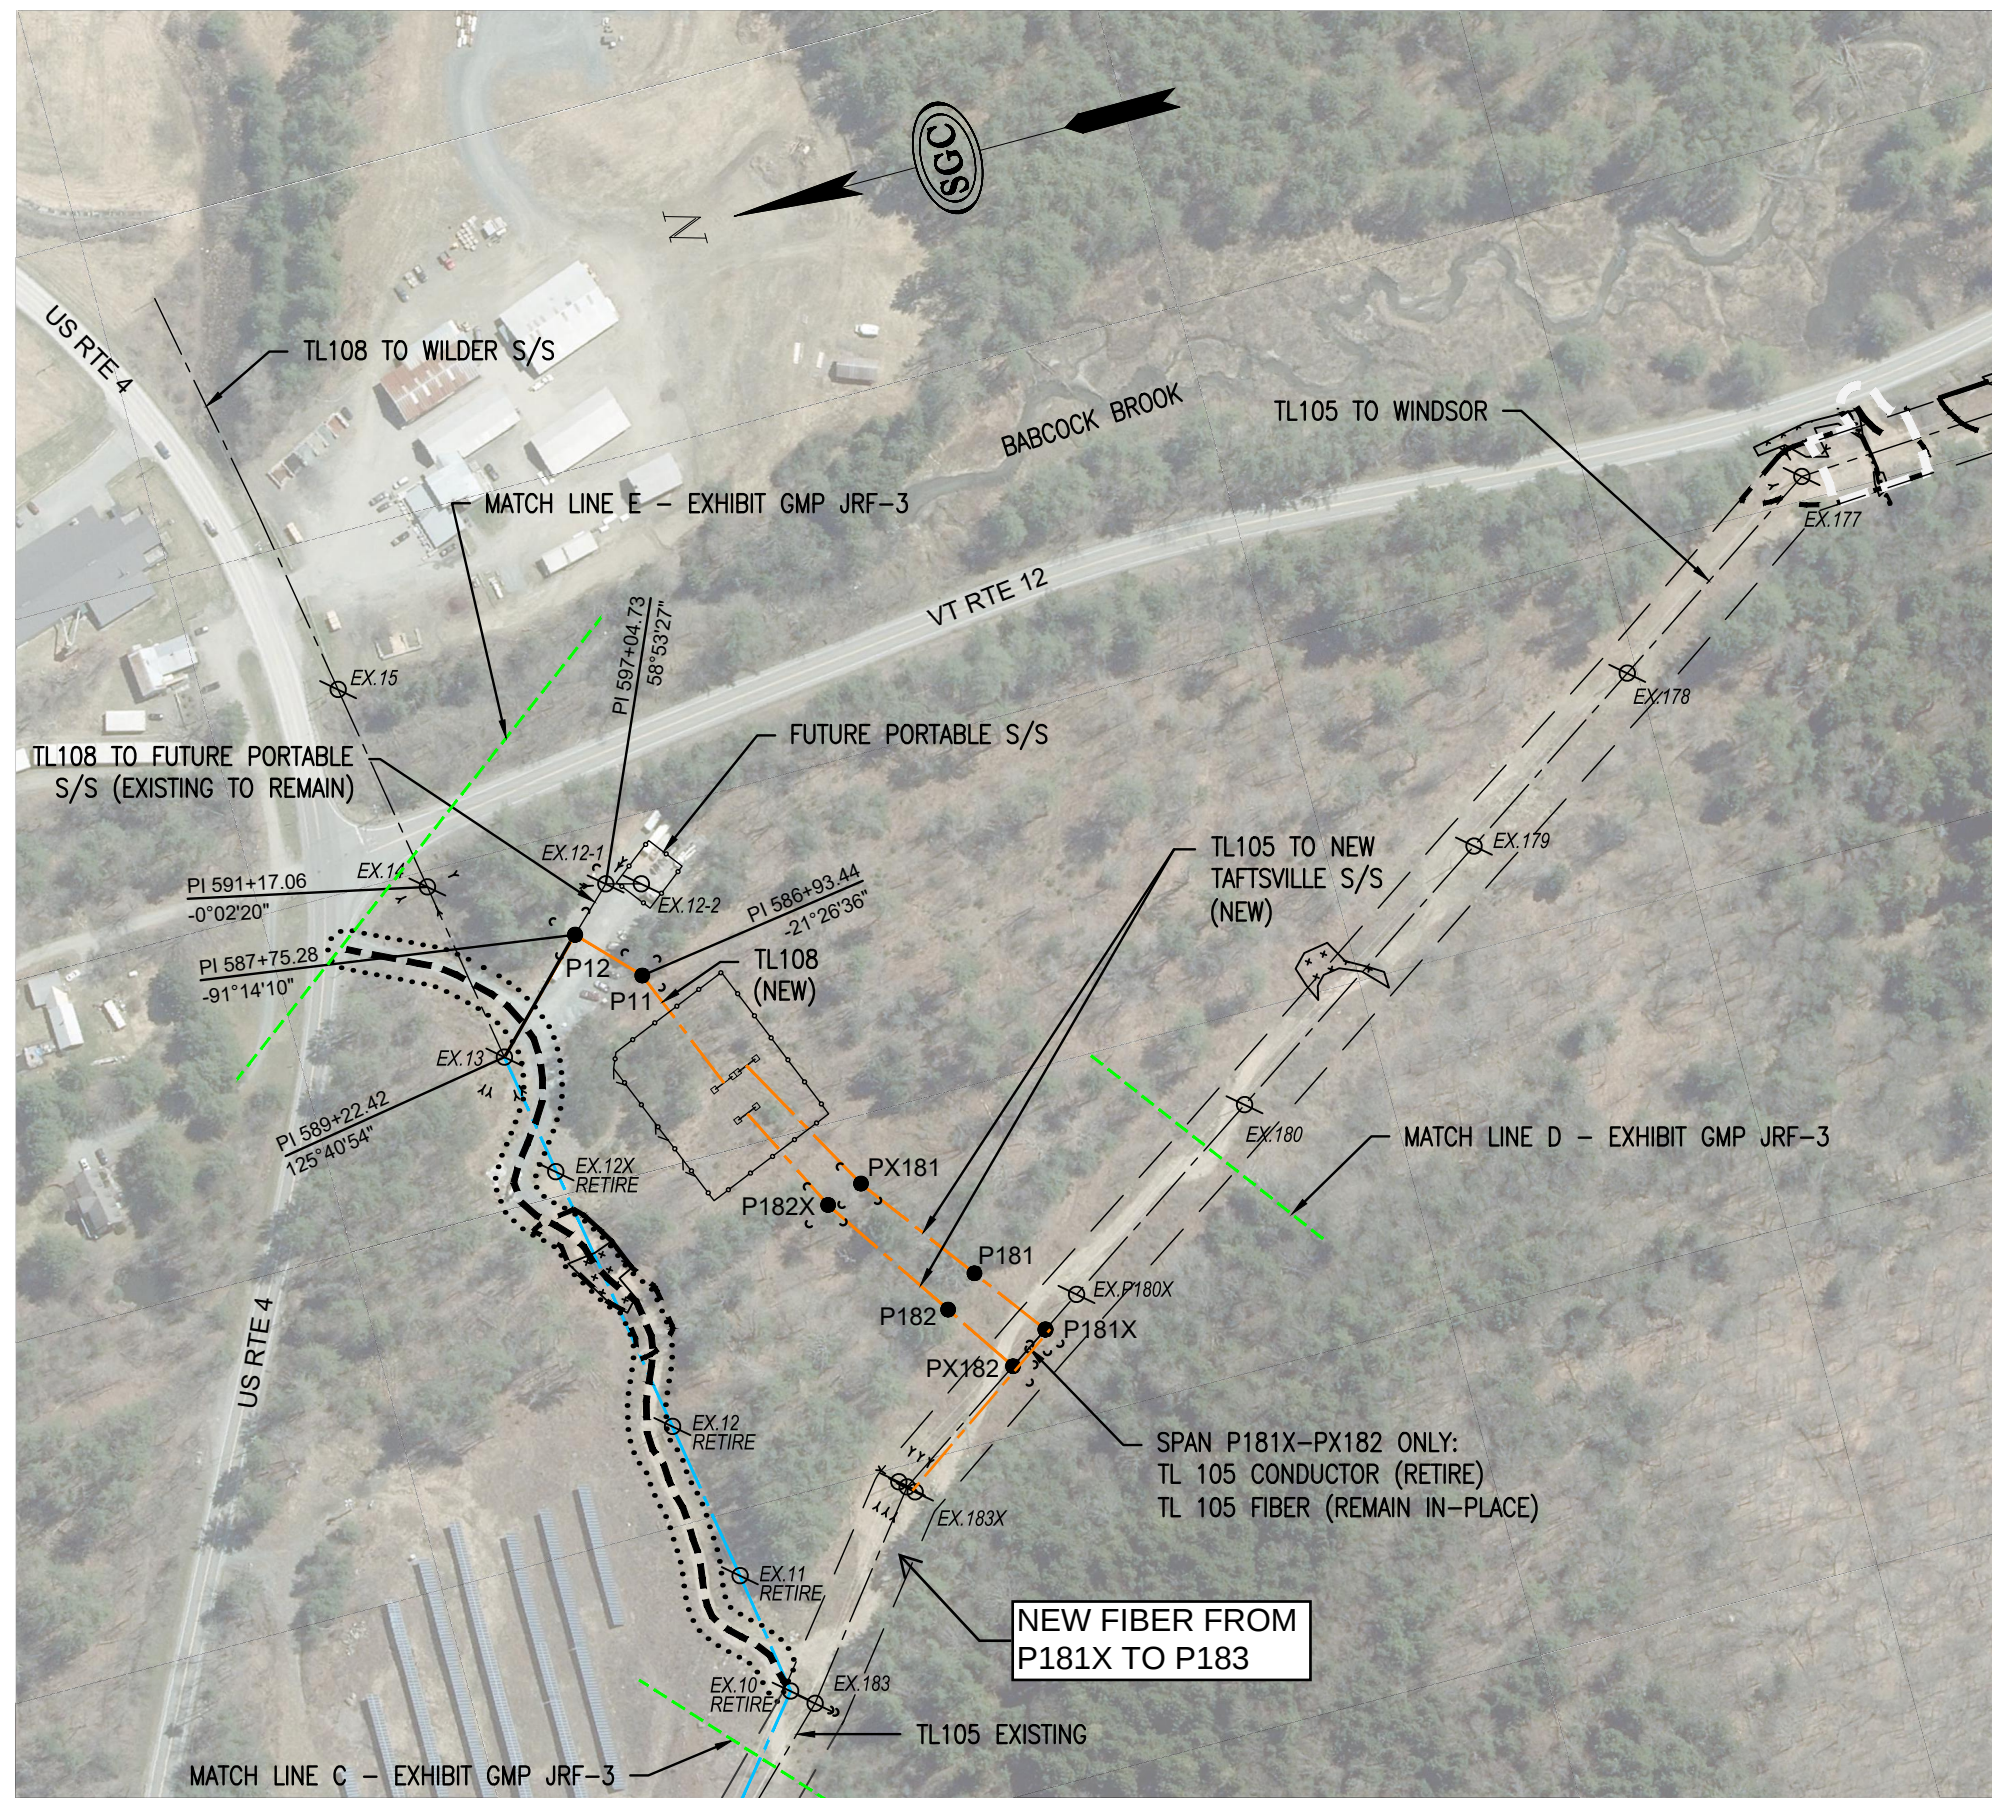

ISSUED FOR PERMIT

DATE: JUNE 09, 2026
SCALE: AS NOTED
DRAWN: SJF
DESIGN: JAE
APPROVED: DLH

ONLY VALID WITH ORIGINAL STAMP

NO.	REVISIONS:	APPD:	DATE:
A	ISSUED FOR PERMIT	DLH	06/09/2026
B	ISSUED FOR PERMIT	DLH	07/31/2026
C	ISSUED FOR PERMIT	DLH	08/11/2026

TITLE:	TL108 PLAN & PROFILE EXHIBIT	SGC PROJECT NUMBER 1291044
PROJECT:	TAFTSVILLE SUBSTATION RELOCATION 46 kV TRANSMISSION LINE	DRAWING NUMBER 1291044-13-1201
CLIENT:	GREEN MOUNTAIN POWER 163 ACORN LANE, COLCHESTER VERMONT, 05446	REVISION C SHEET NUMBER 1 OF 1